



3-149-14

STATE OF FLORIDA
DEPARTMENT OF HEALTH
ONSITE SEWAGE TREATMENT AND DISPOSAL
SYSTEM
APPLICATION FOR CONSTRUCTION PERMIT

PERMIT NO. 05-312-18
DATE PAID: 5/15/18
FEE PAID: 185.00
RECEIPT #: 113763407
AP1344745

APPLICATION FOR:

☐ New System ☐ Existing System ☐ Holding Tank ☐ Innovative
☒ Repair ☐ Abandonment ☐ Temporary ☐

APPLICANT: Alachua County Housing AuthorityAGENT: Newsome well & SepticTELEPHONE: (386) 559-7546MAILING ADDRESS: 12718 NW 77th Ter Alachua

TO BE COMPLETED BY APPLICANT OR APPLICANT'S AUTHORIZED AGENT. SYSTEMS MUST BE CONSTRUCTED BY A PERSON LICENSED PURSUANT TO 489.105(3) (m) OR 489.552, FLORIDA STATUTES. IT IS THE APPLICANT'S RESPONSIBILITY TO PROVIDE DOCUMENTATION OF THE DATE THE LOT WAS CREATED OR PLATTED (MM/DD/YY) IF REQUESTING CONSIDERATION OF STATUTORY GRANDFATHER PROVISIONS.

PROPERTY INFORMATION

LOT: 7 BLOCK: SUBDIVISION: Thistle Hills East PLATTED: 6/24/1970
1996PROPERTY ID #: 04974-007-000 ZONING: R2 I/M OR EQUIVALENT: ☒ Y/NPROPERTY SIZE: .26 ACRES WATER SUPPLY: ☐ PRIVATE PUBLIC ☒ ≤ 2000 GPD ☒ > 2000 IS SEWER AVAILABLE AS PER 381.0065, FS? ☒ Y/N ☐ N DISTANCE TO SEWER: N/APROPERTY ADDRESS: 13615 SW 156th Terrace Archer Fl 32618DIRECTIONS TO PROPERTY: Left onto University Ave. Left onto 11th
Right onto SW County Rd 346, Left onto 156th
destination is on your left

BUILDING INFORMATION

☒ RESIDENTIAL ☐ COMMERCIAL

Unit No	Type of Establishment	No. of Bedrooms	Building Area Sqft	Commercial/Institutional System Design Table 1, Chapter 64E-5, FAC
1	<u>SFR</u>	<u>4</u>	<u>1224</u>	
2				
3				
4				

☐ Floor/Equipment Drains ☐ Other (Specify)

SIGNATURE: [Signature]DATE: 5/8/18

ACHD-EG2701

2010 MAY 15 PM 8 33

A. DENNIS



STATE OF FLORIDA
DEPARTMENT OF HEALTH
ONSITE SEWAGE TREATMENT AND DISPOSAL SYSTEM
EXISTING SYSTEM AND SYSTEM REPAIR EVALUATION

PERMIT # 05-312-18

APPLICANT:

Alachua County Housing Authority

CONTRACTOR / AGENT:

Newsome Well & Septic

LOT:

7

BLOCK:

SUBDIV: Thistle Hills East

ID#: 04974-007

13615 SW 156th Terrace Archer, FL

TO BE COMPLETED BY FLORIDA REGISTERED ENGINEER, DEPARTMENT EMPLOYEE, SEPTIC TANK CONTRACTOR (OTHER CERTIFIED PERSON). SIGN AND SEAL ALL SUBMITTED DOCUMENTS. COMPLETE ALL APPLICABLE ITEM COMPLETE TANK CERTIFICATION BELOW OR NOTE IN REMARKS WHY THE TANKS CANNOT BE CERTIFIED.

EXISTING TANK INFORMATION

1900	GALLONS	103" x 48" x 42"	SEPTIC TANK/GPD ATU	LEGEND: <u>WIP</u>	MATERIAL: <u>PVC</u>	BAFFLED: <u>[Y]</u>
[]	GALLONS		SEPTIC TANK/GPD ATU	LEGEND: <u> </u>	MATERIAL: <u> </u>	BAFFLED: <u>[Y]</u>
[]	GALLONS		GREASE INTERCEPTOR	LEGEND: <u> </u>	MATERIAL: <u> </u>	
[]	GALLONS		DOSING TANK	LEGEND: <u> </u>	MATERIAL: <u> </u>	# PUMPS: <u>1</u>

I CERTIFY THAT THE LISTED TANKS WERE PUMPED ON 4/10/17 BY Phil Newsome. THE VOLUMES SPECIFIED AS DETERMINED BY (DIMENSIONS / FILLING / LEGEND), ARE FREE OF OBSERVABLE DEFECTS OR LEAKS, AND HAVE A (SOLIDS DEFLECTION DEVICE / OUTLET FILTER DEVICE) INSTALLED.

SIGNATURE OF LICENSED CONTRACTOR

BUSINESS NAME

DATE

EXISTING DRAINFIELD INFORMATION

4058 336 SQUARE FEET PRIMARY DRAINFIELD SYSTEM NO. OF TRENCHES 4 DIMENSIONS: 14' x 35'
[] SQUARE FEET SYSTEM NO. OF TRENCHES [] DIMENSIONS: []
TYPE OF SYSTEM: [X] STANDARD [] FILLED [] MOUND [] Rock Chambers, ARE 24
CONFIGURATION: [] TRENCH [X] BED []
DESIGN: [X] HEADER [] D-BOX [X] GRAVITY SYSTEM [] DOSED SYSTEM
ELEVATION OF BOTTOM OF DRAINFIELD IN RELATION TO EXISTING GRADE 36.30 INCHES [ABOVE /] (BE)

SYSTEM FAILURE AND REPAIR INFORMATION

1967 SYSTEM INSTALLATION DATE TYPE OF WASTE [X] DOMESTIC [] COMMERCIAL
400 GPD ESTIMATED SEWAGE FLOW BASED ON [] METERED WATER [X] TABLE 1, GAE-6,

SITE [] DRAINAGE STRUCTURES [] POOL [] PATIO / DECK [] PARKING
CONDITIONS: [] SLOPING PROPERTY []

NATURE OF [] HYDRAULIC OVERLOAD [] SOILS [X] MAINTENANCE [] SYSTEM DAMAGE
FAILURE: [] DRAINAGE / RUN OFF [] ROOTS [] WATER TABLE [X] ~~Other~~

FAILURE [] SEWAGE ON GROUND [] TANK [] D BOX/HEADER [X] DRAINFIELD
SYMPTOM: [X] PLUMBING BACKUP []

REMARKS/ADDITIONAL CRITERIA Replace to Repair standards.

SUBMITTED BY: [Signature]

TITLE/LICENSE CEHP-17-1159

DATE: 5/8/17

DH 4015, 08/89 (Obsoletes previous editions which may not be used)

Incorporated GAE-6.001, FAC

REV



STATE OF FLORIDA
DEPARTMENT OF HEALTH
ONSITE SEWAGE TREATMENT AND DISPOSAL SYSTEM
SITE EVALUATION AND SYSTEM SPECIFICATIONS

PERMIT #. 5-312-18

APPLICANT: Alachua County Housing Auth. AGENT: Newsome Well & Septic

LOT: 7 BLOCK: _____ SUBDIVISION: Thistle Hills East

PROPERTY ID #: 04974-007-000 [Section/Township/Parcel No. or Tax ID Number]

TO BE COMPLETED BY ENGINEER, HEALTH DEPARTMENT EMPLOYEE, OR OTHER QUALIFIED PERSON. ENGINEERS MUST PROVIDE REGISTRATION NUMBER AND SIGN AND SEAL EACH PAGE OF SUBMITTAL. COMPLETE ALL ITEMS.

PROPERTY SIZE CONFORMS TO SITE PLAN: ☒ YES ☐ NO NET USABLE AREA AVAILABLE: 0.26 ACRES
TOTAL ESTIMATED SEWAGE FLOW: 400 GALLONS PER DAY [RESIDENCES-TABLE 1/OTHER-TABLE 2]
AUTHORIZED SEWAGE FLOW: 650 GALLONS PER DAY [1500 GPD/ACRE OR 2500 GPD/ACRE]
UNOBSTRUCTED AREA AVAILABLE: 10000 SQFT UNOBSTRUCTED AREA REQUIRED: 608 SQFT

BENCHMARK/REFERENCE POINT LOCATION: Orange Painted Nail in Power Pole @ site
ELEVATION OF PROPOSED SYSTEM SITE IS 25 (INCHES/FT) [ABOVE/BELOW] BENCHMARK/REFERENCE POINT

THE MINIMUM SETBACK WHICH CAN BE MAINTAINED FROM THE PROPOSED SYSTEM TO THE FOLLOWING FEATURES
SURFACE WATER: NA FT DITCHES/SWALES: NA FT NORMALLY WET? ☐ YES ☒ NO
WELLS: PUBLIC: NA FT LIMITED USE: NA FT PRIVATE: NA FT NON-POTABLE: NA FT
BUILDING FOUNDATIONS: 7 FT PROPERTY LINES: 5 FT POTABLE WATER LINES: 19 FT

SITE SUBJECT TO FREQUENT FLOODING: ☐ YES ☒ NO 10 YEAR FLOODING? ☐ YES ☒ NO
10 YEAR FLOOD ELEVATION FOR SITE: NA FT MSL/NGVD SITE ELEVATION: NA FT MSL/NGVD

SOIL PROFILE INFORMATION SITE 1 - 25' BM

MUNSELL #/COLOR	TEXTURE	DEPTH
10YR 3/1	FS	0 TO 4
10YR 4/1, 5/2	FS	4 TO 28
10YR 4/1, 5/2, 6/4	FS	28 TO 40
10YR 6/4, 8/1, 5/6	FS	40 TO 50
10YR 7/4, 8/1, 5/6	FS	50 TO 54
10YR 7/2, 8/1, 5/6	FS	54 TO 72
10YR 5/6	clay lim. Rf	70 TO 72
		TO
		TO

USDA SOIL SERIES: Mapped Arundel

SOIL PROFILE INFORMATION SITE 2 - 32' BM

MUNSELL #/COLOR	TEXTURE	DEPTH
10YR 3/1	FS	0 TO 4
10YR 4/1, 5/4, 5/6	FS	4 TO 7
10YR 5/4, 5/6	FS	7 TO 16
10YR 6/4, 7/4, 5/6	FS	16 TO 36
10YR 7/2, 7/4, 8/1, striping		36 TO 50
10YR 5/6	clay lim. Rf	36 TO 50
10YR 6/4, 6/4, 7.5YR 5/8, 5/6	SL	50 TO 58
10YR 6/6, 6/4, 7.5YR 5/8, 5/6	SL	58 TO 72
		TO

USDA SOIL SERIES: Mapped Arundel

OBSERVED WATER TABLE: 72 INCHES [ABOVE / BELOW] EXISTING GRADE. TYPE: [PERCHED / APPARENT]
ESTIMATED WET SEASON WATER TABLE ELEVATION: 36 INCHES [ABOVE / BELOW] EXISTING GRADE
HIGH WATER TABLE VEGETATION: ☐ YES ☒ NO MOTTILING: ☒ YES ☐ NO DEPTH: 36 INCHES

SOIL TEXTURE/LOADING RATE FOR SYSTEM SIZING: Table VI DEPTH OF EXCAVATION: 61 INCHES
DRAINFIELD CONFIGURATION: ☒ TRENCH ☐ BED ☐ OTHER (SPECIFY) _____

REMARKS/ADDITIONAL CRITERIA: _____

SITE EVALUATED BY: [Signature] DATE: 6-1-18

A. DENNIS

2018 JUN 1 PM 12 05

ACHD-EE22701



STATE OF FLORIDA
DEPARTMENT OF HEALTH
ONSITE SEWAGE TREATMENT AND DISPOSAL
SYSTEM

5-712-18
PERMIT #: 01-SA-1847462
APPLICATION #: AP1344745
DATE PAID: _____
FEE PAID: _____
RECEIPT #: _____
DOCUMENT #: PR1120261

CONSTRUCTION PERMIT FOR: OSTDS Repair
APPLICANT: (Alachua County Housing Authority Lot 7)
PROPERTY ADDRESS: 13615 SW 156th Ter Archer, FL 32618
LOT: 7 BLOCK: W/A SUBDIVISION: Thistle Hills East
PROPERTY ID #: 04974-007-000 [SECTION, TOWNSHIP, RANGE, PARCEL NUMBER]
[OR TAX ID NUMBER]

SYSTEM MUST BE CONSTRUCTED IN ACCORDANCE WITH SPECIFICATIONS AND STANDARDS OF SECTION 381.0065, F.S., AND CHAPTER 64E-6, F.A.C. DEPARTMENT APPROVAL OF SYSTEM DOES NOT GUARANTEE SATISFACTORY PERFORMANCE FOR ANY SPECIFIC PERIOD OF TIME. ANY CHANGE IN MATERIAL FACTS, WHICH SERVED AS A BASIS FOR ISSUANCE OF THIS PERMIT, REQUIRE THE APPLICANT TO MODIFY THE PERMIT APPLICATION. SUCH MODIFICATIONS MAY RESULT IN THIS PERMIT BEING MADE NULL AND VOID. ISSUANCE OF THIS PERMIT DOES NOT EXEMPT THE APPLICANT FROM COMPLIANCE WITH OTHER FEDERAL, STATE, OR LOCAL PERMITTING REQUIRED FOR DEVELOPMENT OF THIS PROPERTY.

SYSTEM DESIGN AND SPECIFICATIONS

T [900] GALLONS / GPD Ex Septic CAPACITY
A [0] GALLONS / GPD CAPACITY
N [0] GALLONS GREASE INTERCEPTOR CAPACITY [MAXIMUM CAPACITY SINGLE TANK:1250 GALLONS]
K [] GALLONS DOSING TANK CAPACITY [] GALLONS @ [] DOSES PER 24 HRS #Pumps []
D [405] SQUARE FEET Drainfield Replacement SYSTEM
R [0] SQUARE FEET SYSTEM
A TYPE SYSTEM: [x] STANDARD [] FILLED [] MOUND []
I CONFIGURATION: [x] TRENCH [] BED []
N
F LOCATION OF BENCHMARK: Painted Nail in Power Pole
I ELEVATION OF PROPOSED SYSTEM SITE [25.00] [INCHES / FT] [ABOVE / BELOW] BENCHMARK / REFERENCE POINT
E BOTTOM OF DRAINFIELD TO BE [55.00] [INCHES / FT] [ABOVE / BELOW] BENCHMARK / REFERENCE POINT
L
D FILL REQUIRED: [0.00] INCHES EXCAVATION REQUIRED: [] INCHES

O The system is sized for 4 bedrooms with a maximum occupancy of 8 persons (2 per bedroom), for a total estimated flow of
T 400 gpd. ACHD encourages 500ft2 drainfield and at least a 12" ESHWT separation. This system was previously repaired
H 4/1/14. Remove existing drainfield from proposed drainfield area and properly dispose with spoils. Private site evaluation
E shall be confirmed at time of installation inspection.
R

SPECIFICATIONS BY: John Mayfield TITLE: CEHP
APPROVED BY: Todd S Harris TITLE: Assistant EH Director Alachua CHD
DATE ISSUED: 06/06/2018 EXPIRATION DATE: 09/04/2018
DH 4016, 08/09 (Obsoletes all previous editions which may not be used)
Incorporated: 64E-6.003, FAC

NOTICE OF RIGHTS

A party whose substantial interest is affected by this order may petition for an administrative hearing pursuant to sections 120.569 and 120.57, Florida Statutes. Such proceedings are governed by Rule 28-106, Florida Administrative Code. A petition for administrative hearing must be in writing and must be received by the Agency Clerk for the Department, within twenty-one (21) days from the receipt of this order. The address of the Agency Clerk is 4052 Bald Cypress Way, BIN A-02, Tallahassee, Florida 32399. The Agency Clerk's facsimile number is 850-413-8743.

Mediation is not available as an alternative remedy.

Your failure to submit a petition for hearing within 21 days from receipt of this order will constitute a waiver of your right to an administrative hearing, and this order shall become a 'final order'.

Should this order become a final order, a party who is adversely affected by it is entitled to judicial review pursuant to Section 120.68, Florida Statutes. Review proceedings are governed by the Florida Rules of Appellate Procedure. Such proceedings may be commenced by filing one copy of a Notice of Appeal with the Agency Clerk of the Department of Health and a second copy, accompanied by the filing fees required by law, with the Court of Appeal in the appropriate District Court. The notice must be filed within 30 days of rendition of the final order.

Harris, Todd S

From: Harris, Todd S
Sent: Thursday, May 31, 2018 2:26 PM
To: 'flsepticsolutions@yahoo.com'
Subject: 05-312-18 Lot 7 TH E

- Existing drainfield amount is 405 ft² from repair 4 years ago
 - Revise 4015 and associated calcs
 - Is age still a cause of system failure?
- Existing drainfield location not shown on site plan
- Driveway and parking area not shown on site plan
- ~~Soil profiles should be done over proposed drainfield area~~
 - Appears should be Table VII based on the soil texture *NA*
 - Installing in bed as Table VII will require greater area than indicated *NA*
 - Can the df fit in this area? House is angled and a lot bigger than indicated on plan
 - Appears there should be a 45" ESHWT based on description and mottling(?) but listed as 72


Todd Harris
Environmental Manager
Florida Department of Health in Alachua County
224 SE 24th St.
Gainesville, FL 32641
Office 352-334-7932
Fax 352-334-7935


Please note: Florida has a very broad public records law. Most written communications to or from state officials regarding state business are public records available to the public and media upon request. Your e-mail communications may therefore be subject to public disclosure

SCC

Wiley Ruck

} 12⁴

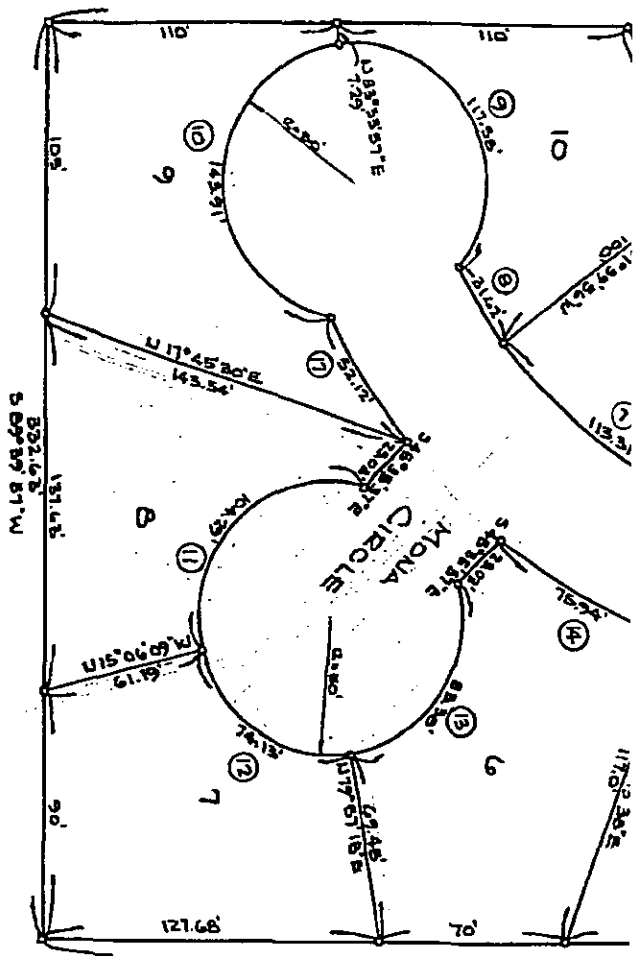


 SCALE 1"=50'
 o Denotes Concrete Monument (P.R.M.)
 o Denotes Iron Pipe



Property Search Results

The data displayed is the most current data available to the Property Appraiser.

Search Date: 5/15/2018 at 8:27:43 AM

Printer Friendly Page

Parcel: 04974-007-000 GIS Map

Taxpayer:	ALACHUA COUNTY HOUSING, AUTHOR	Legal: THISTLE HILLS EAST PB H-27 LOT 7 OR 804/350
Mailing:	701 NE 1ST ST GAINESVILLE, FL 32601	
9-1-1 Address:	13615 SW 156TH TER ARCHER	
Sec-Twn-Rng:	16-11-18	
Property Use:	08600 - Cty Inc Nonmuni	
Tax Jurisdiction:	Archer 2700	
Area:	City of Archer	
Subdivision:	Thistle Hills East	


Year	Property Use	Land Value	Land Just Value	Building Value	Misc Value	Total Just Value	Deferred Value	County Assessed	School Assessed	County Exempt	School Exempt	County Taxable	School Taxable
2017	Cty Inc Nonmuni	16000	16000	46400	100	62500	0	62500	62500	62500	62500	0	0
2016	Cty Inc Nonmuni	16000	16000	43400	100	59500	0	59500	59500	59500	59500	0	0
2015	Cty Inc Nonmuni	16000	16000	44300	100	60400	0	60400	60400	60400	60400	0	0
2014	Cty Inc Nonmuni	16000	16000	44500	100	60600	0	60600	60600	60600	60600	0	0
2013	Cty Inc Nonmuni	16000	16000	45400	100	61500	0	61500	61500	61500	61500	0	0
2012	Cty Inc Nonmuni	16000	16000	46300	100	62400	0	62400	62400	62400	62400	0	0
2011	Cty Inc Nonmuni	16000	16000	48900	100	65000	0	65000	65000	65000	65000	0	0
2010	Cty Inc Nonmuni	16000	16000	51700	100	67800	0	67800	67800	67800	67800	0	0
2009	Cty Inc Nonmuni	16000	16000	56000	100	72100	0	72100	72100	72100	72100	0	0
2008	Single Family	16000	16000	62200	100	78300	0	78300	0	78300	0	0	0

Land

Use	Zoning Type	Zoning Desc	Unit Type	Units
SFR	R-2		Unit	1

Building

Actual Year Built	1967
Effective Year Built	1967
Building Quality	Average
Building Style	01
Building Use	0100 - Single Family
Bedrooms	4
Baths	1.5
Stories	1.0
Exterior Wall 1	Concrete Block
Exterior Wall 2	N/A
Interior Wall 1	Drywall
Interior Wall 2	N/A
Floor Cover 1	Cork Tile
Floor Cover 2	N/A
Roof Cover	Asphalt
Roof Structure	Gable/Hip
AC	Roof Top Air
Heating Type	Convection
Heating System	Electric
Total Square Feet	1304
Heated Square Feet	1224
Area Type	Square Footage
BAS (BASE AREA)	1224



Miscellaneous

Description	Unit Type	Units
4680 - Paving 1	SF	250

Permit


County Permit information is supplied by the Alachua County Office of Codes Enforcement. The Alachua County Office of Codes Enforcement and the Property Appraiser's Office assume no liability whatsoever associated with the use or misuse of this public information data and will not be held liable as to the validity, correctness, accuracy, completeness, and / or reliability of this data.

Permit Number	Permit Type	Issue Date	Final Date	Appraisal Date	Comment
2015110332	RR	11/19/2015	11/30/2015	01/11/2016	RE-ROOF WITH SHINGLES
2015110300	RAD	11/17/2015	01/08/2016	01/11/2016	ROOF REPAIR(2 TRUSSES)

[Link to TaxCollector Record](#)

The information that is supplied by the Alachua County Property Appraiser's office is public information data and must be accepted and used with the understanding that the data was collected primarily for the use and purpose of creating a Property Tax Roll per Florida Statute. The Alachua County Property Appraiser's Office will not be held liable as to the validity, correctness, accuracy, completeness, and / or reliability of this data. The Alachua County Property Appraiser's Office furthermore assumes no liability whatsoever associated with the use or misuse of this public information data.

Alachua County Property Appraiser • 515 N Main Street Suite 200 • Gainesville, FL 32601 • 352-374-5230 (FAX) 352-374-5278





STATE OF FLORIDA
DEPARTMENT OF HEALTH
ONSITE SEWAGE TREATMENT AND DISPOSAL SYSTEM
SITE EVALUATION AND SYSTEM SPECIFICATIONS

PERMIT #. 05-312-18

APPLICANT: Alachua County Housing Authority AGENT: Newsome Well & Septe
LOT: 7 BLOCK: _____ SUBDIVISION: Thistle Hills East
PROPERTY ID #: 04974-007-000 [Section/Township/Parcel No. or Tax ID Number]

TO BE COMPLETED BY ENGINEER, HEALTH DEPARTMENT EMPLOYEE, OR OTHER QUALIFIED PERSON. ENGINEERS MUST PROVIDE REGISTRATION NUMBER AND SIGN AND SEAL EACH PAGE OF SUBMITTAL. COMPLETE ALL ITEMS.

PROPERTY SIZE CONFORMS TO SITE PLAN: ☒ YES ☐ NO NET USABLE AREA AVAILABLE: 126 ACRES
TOTAL ESTIMATED SEWAGE FLOW: 400 GALLONS PER DAY [RESIDENCES-TABLE 1/OTHER-TABLE 2]
AUTHORIZED SEWAGE FLOW: 650 GALLONS PER DAY [1500 GPD/ACRE OR 2500 GPD/ACRE]
UNOBSTRUCTED AREA AVAILABLE: 1000 SQFT UNOBSTRUCTED AREA REQUIRED: 600 SQFT

BENCHMARK/REFERENCE POINT LOCATION: Orange Painted Nail in Power Pole at site.
ELEVATION OF PROPOSED SYSTEM SITE IS 25 [INCHES/FT] [ABOVE/BELOW] BENCHMARK/REFERENCE POINT

THE MINIMUM SETBACK WHICH CAN BE MAINTAINED FROM THE PROPOSED SYSTEM TO THE FOLLOWING FEATURES
SURFACE WATER: NA FT DITCHES/SWALES: NA FT NORMALLY WET? ☐ YES ☒ NO
WELLS: PUBLIC: NA FT LIMITED USE: NA FT PRIVATE: NA FT NON-POTABLE: NA FT
BUILDING FOUNDATIONS: 7 FT PROPERTY LINES: 10 FT POTABLE WATER LINES: 26 FT

SITE SUBJECT TO FREQUENT FLOODING: ☐ YES ☒ NO 10 YEAR FLOODING? ☐ YES ☒ NO
10 YEAR FLOOD ELEVATION FOR SITE: _____ FT MSL/NGVD SITE ELEVATION: _____ FT MSL/NGVD

SOIL PROFILE INFORMATION SITE 1 25" below RP

MUNSELL #/COLOR	TEXTURE	DEPTH
10YR 4/1	FS	0 TO 6
10YR 4/2	FS	6 TO 19
10YR 6/4, 4/4	FS	19 TO 32
10YR 5/4, 7.5YR 5/6	SL	32 TO 40
10YR 6/4, 7.5YR 5/6, 5/8	SL SL	40 TO 50
10YR 5/4, 6/3, 7.5YR 5/6, 1FS	LS	50 TO 68
10YR 6/4, 7.5YR 5/6, 1/8	SL	68 TO 72
		TO
		TO
USDA SOIL SERIES: <u>Mapped Arcadado</u>		

SOIL PROFILE INFORMATION SITE 2 27" below RP

MUNSELL #/COLOR	TEXTURE	DEPTH
10YR 4/1, 4/2	FS	0 TO 14
10YR 5/4, 4/4	FS	14 TO 24
10YR 6/4, 8/1	FS	24 TO 45
10YR 5/6	FS	24 TO 45
10YR 8/2, 8/1	FS	45 TO 50
7.5YR 5/6	FS	45 TO 50
7.5YR 5/6	LS	50 TO 56
7.5YR 5/6, 5/8	SL	56 TO 72
10YR 6/4	SL	56 TO 72
USDA SOIL SERIES: <u>Mapped Arcadado</u>		

OBSERVED WATER TABLE: 72" INCHES [ABOVE/BELOW] EXISTING GRADE. TYPE: [PERCHED] ☒ APPARENT
ESTIMATED WET SEASON WATER TABLE ELEVATION: 72" INCHES [ABOVE/BELOW] EXISTING GRADE
HIGH WATER TABLE VEGETATION: ☐ YES ☒ NO MOTTILING: ☒ YES ☐ NO DEPTH: 45 INCHES

SOIL TEXTURE/LOADING RATE FOR SYSTEM SIZING: .8 FS/Table IV DEPTH OF EXCAVATION: old drain field INCHES
DRAINFIELD CONFIGURATION: ☒ TRENCH ☒ BED ☐ OTHER (SPECIFY)
REMARKS/ADDITIONAL CRITERIA: Replace to Repair Standards

SITE EVALUATED BY: CEHP 17-1155 DATE: 5/8/18

Fax to Myer's



STATE OF FLORIDA
DEPARTMENT OF HEALTH
ONSITE SEWAGE TREATMENT AND DISPOSAL
SYSTEM
APPLICATION FOR CONSTRUCTION PERMIT

PERMIT NO. 03-149-14
DATE PAID: 3/19/14
FEE PAID: 185.00
RECEIPT #: AD114004
1432-2439814

APPLICATION FOR:

☒ New System ☐ Existing System ☐ Holding Tank ☐ Innovative
☒ Repair ☐ Abandonment ☐ Temporary ☐

APPLICANT: Alachua County Housing Authority

AGENT: Ronnie Moore

TELEPHONE: 352-246-3997

MAILING ADDRESS: PO BOX 158 FT White FL 32038

TO BE COMPLETED BY APPLICANT OR APPLICANT'S AUTHORIZED AGENT. SYSTEMS MUST BE CONSTRUCTED BY A PERSON LICENSED PURSUANT TO 489.105(3) (m) OR 489.552, FLORIDA STATUTES. IT IS THE APPLICANT'S RESPONSIBILITY TO PROVIDE DOCUMENTATION OF THE DATE THE LOT WAS CREATED OR PLATTED (MM/DD/YY) IF REQUESTING CONSIDERATION OF STATUTORY GRANDFATHER PROVISIONS.

PROPERTY INFORMATION

06-11-18

LOT: 7 BLOCK: H-27 SUBDIVISION: Thistle Hills East PLATTED: 1967

PROPERTY ID #: 04974-007-002 ZONING: R-2 I/M OR EQUIVALENT: ☒ Y ☐ N

PROPERTY SIZE: 0.23 ACRES WATER SUPPLY: ☐ PRIVATE PUBLIC 4-2000GPD ☒ >2000GPD

IS SEWER AVAILABLE AS PER 381.0065, FS? ☒ Y ☐ N DISTANCE TO SEWER: 114 FT

PROPERTY ADDRESS: 13615 SW 156 Terr Archer Fl 32618

DIRECTIONS TO PROPERTY: Archer Rd west to 27/41 T/L to 346 T/L
Follow to SW 156 Terr T/R to # 13615 on LEFT

BUILDING INFORMATION

☒ RESIDENTIAL

☐ COMMERCIAL

Unit No	Type of Establishment	No. of Bedrooms	Building Area Sqft	Commercial/Institutional System Design Table 1, Chapter 64E-6, FAC
---------	-----------------------	-----------------	--------------------	--

1

2

3

4

☐ Floor/Equipment Drains ☐ Other (Specify)

SIGNATURE: Ronnie Moore

DATE: 3/17/14

DH 4015, 08/09 (Obsoletes previous editions which may not be used)
Incorporated 64E-6.001, FAC



Catrina
STATE OF FLORIDA
DEPARTMENT OF HEALTH
ONSITE SEWAGE TREATMENT AND DISPOSAL SYSTEM
CONSTRUCTION INSPECTION AND FINAL APPROVAL

PERMIT NO. 13-149-14
DATE PAID: 4/1/14
FEE PAID: 1850
RECEIPT #: 104140014
1-B.d. 2439814

APPLICANT: Alachua County Housing Authority

AGENT: Woods, Ranie

PROPERTY ADDRESS: 1361 S.W. 15th Avenue Acheson #1 32618

LOT: 7 BLOCK: H21 SUBDIVISION: Trickle Hills East PROPERTY ID #: 04976-1007-010

CHECKED [X] ITEMS ARE NOT IN COMPLIANCE WITH STATUTE OR RULE AND MUST BE CORRECTED.

TANK INSTALLATION

- [] [01] TANK SIZE [1] 900 (2) concrete
[] [02] TANK MATERIAL concrete
[] [03] OUTLET DEVICE SD
[] [04] MULTI-CHAMBERED [Y / N]
[] [05] OUTLET FILTER ---
[] [06] LEGEND ---
[] [07] WATERTIGHT ---
[] [08] LEVEL ---
[] [09] DEPTH TO LID 3 x 7 + 6

SETBACKS

- [] [27] SURFACE WATER --- FT
[] [28] DITCHES --- FT
[] [29] PRIVATE WELLS --- FT
[] [30] PUBLIC WELLS --- FT
[] [31] IRRIGATION WELLS --- FT
[] [32] POTABLE WATER LINES 18-19 FT
[] [33] BUILDING FOUNDATION 5 FT
[] [34] PROPERTY LINES 5 FT
[] [35] OTHER --- FT

DRAINFIELD INSTALLATION

- [] [10] AREA [1] 405 [2] --- SQFT
[] [11] DISTRIBUTION BOX --- HEADER ✓
[] [12] NUMBER OF DRAINLINES 4
[] [13] DRAINLINE SEPARATION ---
[] [14] DRAINLINE SLOPE ---
[] [15] DEPTH OF COVER ---
[] [16] ELEVATION [ABOVE/BELOW] BM 60
[] [17] SYSTEM LOCATION ---
[] [18] DOSING PUMPS ---
[] [19] AGGREGATE SIZE ---
[] [20] AGGREGATE EXCESSIVE FINES ---
[] [21] AGGREGATE DEPTH ---

FILLED / MOUND SYSTEM

- [] [36] DRAINFIELD COVER ---
[] [37] SHOULDERS ---
[] [38] SLOPES ---
[] [39] STABILIZATION ---

FILL / EXCAVATION MATERIAL

- [] [22] FILL AMOUNT ---
[] [23] FILL TEXTURE ---
[] [24] EXCAVATION DEPTH ---
[] [25] AREA REPLACED ---
[] [26] REPLACEMENT MATERIAL ---

ADDITIONAL INFORMATION

- [] [40] UNOBSTRUCTED AREA ---
[] [41] STORMWATER RUNOFF ---
[] [42] ALARMS ---
[] [43] MAINTENANCE AGREEMENT ---
[] [44] BUILDING AREA ---
[] [45] LOCATION CONFORMS WITH SITE PLAN ---
[] [46] FINAL SITE GRADING ---
[] [47] CONTRACTOR Myers
[] [48] OTHER Are 24 in (cloth) 27

ABANDONMENT

- [] [49] TANK PUMPED ---
[] [50] TANK CRUSHED & FILLED ---

EXPLANATION OF VIOLATIONS / REMARKS:

- [] ---
[] ---
[] Soil OK
[] ---

CONSTRUCTION [APPROVED/DISAPPROVED]: David Bennett Alachua CHD DATE: 4/1/14

FINAL SYSTEM [APPROVED/DISAPPROVED]: David Bennett Alachua CHD DATE: 4/1/14



STATE OF FLORIDA
DEPARTMENT OF HEALTH
ON-SITE SEWAGE TREATMENT AND DISPOSAL SYSTEM
CONSTRUCTION INSPECTION AND FINAL APPROVAL

APPLICATION #: AP1140004

PERMIT #: 01-SA-1527791

DOCUMENT #: F1948539

DATE PAID: 03/19/2014

FEE PAID: 185.00

RECEIPT #: 1-PID-2363819

APPLICANT: Alachua County Housing Authority

AGENT: Ronnie Moore

PROPERTY ADDRESS: 13615 SW 156th Ter Archer, FL 32618

LOT: 7

BLOCK: H-27

SUBDIVISION: Thistle Hills East

ID#: 04974-007-000

CHECKED [X] ITEMS ARE NOT IN COMPLIANCE WITH STATUTE OR RULE AND MUST BE CORRECTED.

TANK INSTALLATION		SETBACKS	
[]	[01] TANK SIZE [1] 900.00 <u>Ex</u> [2] <u>NA</u>	[]	[27] SURFACE WATER <u>—</u> FT
[]	[02] TANK MATERIAL <u>Concrete</u>	[]	[28] DITCHES <u>—</u> FT
[]	[03] OUTLET DEVICE <u>SD</u>	[]	[29] PRIVATE WELLS <u>—</u> FT
[]	[04] MULTI-CHAMBERED [] Y [] N	[]	[30] PUBLIC WELLS <u>—</u> FT
[]	[05] OUTLET FILTER <u>—</u>	[]	[31] IRRIGATION WELLS <u>—</u> FT
[]	[06] LEGEND 1. <u>Unknown</u> 2. <u>—</u>	[]	[32] POTABLE WATER <u>19</u> FT
[]	[07] WATERTIGHT <u>—</u>	[]	[33] BUILDING FOUNDATIONS <u>5</u> FT
[]	[08] LEVEL <u>—</u>	[]	[34] PROPERTY LINES <u>5</u> FT
[]	[09] DEPTH TO LID <u>—</u>	[]	[35] OTHER <u>—</u> FT
DRAINFIELD INSTALLATION		FILLED / MOUND SYSTEM	
[]	[10] AREA [1] <u>405</u> [2] <u>—</u> SQFT	[]	[36] DRAINFIELD COVER <u>—</u>
[]	[11] DISTRIBUTION <u>BOX</u> <u>—</u> HEADER <u>X</u>	[]	[37] SHOULDERS <u>—</u>
[]	[12] NUMBER OF DRAINLINES <u>1, 400</u> 2. <u>—</u>	[]	[38] SLOPES <u>—</u>
[]	[13] DRAINLINE SEPARATION <u>—</u>	[]	[39] STABILIZATION <u>—</u>
[]	[14] DRAINLINE SLOPE <u>—</u>	ADDITIONAL INFORMATION	
[]	[15] DEPTH OF COVER <u>—</u>	[]	[40] UNOBSTRUCTED AREA <u>—</u>
[]	[16] ELEVATION [] ABOVE [] <u>BELOW</u> <u>1RM 60.00</u>	[]	[41] STORMWATER RUNOFF <u>—</u>
[]	[17] SYSTEM LOCATION <u>—</u>	[]	[42] ALARMS <u>—</u>
[]	[18] DOSING PUMPS <u>—</u>	[]	[43] MAINTENANCE AGREEMENT <u>—</u>
[]	[19] AGGREGATE SIZE <u>—</u>	[]	[44] BUILDING AREA <u>—</u>
[]	[20] AGGREGATE EXCESSIVE FINES <u>—</u>	[]	[45] LOCATION CONFORMS WITH SITE PLAN <u>—</u>
[]	[21] AGGREGATE DEPTH <u>—</u>	[]	[46] FINAL SITE GRADING <u>—</u>
FILL / EXCAVATION MATERIAL		[]	[47] CONTRACTOR <u>(Myers Brothers Septic Tank)</u>
[]	[22] FILL AMOUNT <u>—</u>	[]	[48] OTHER <u>#27 ADS ARC 24 v1 c1014</u>
[]	[23] FILL TEXTURE <u>—</u>	ABANDONMENT	
[]	[24] EXCAVATION DEPTH <u>—</u>	[]	[49] TANK PUMPED <u>NA</u>
[]	[25] AREA REPLACED <u>—</u>	[]	[50] TANK CRUSHED & FILLED <u>—</u>
[]	[26] REPLACEMENT MATERIAL <u>—</u>		

Comments: Comments are on page 2.

CONSTRUCTION [] APPROVED [] DISAPPROVED [] DATE: 04/01/2014

FINAL SYSTEM [] APPROVED [] DISAPPROVED [] DATE: 04/01/2014

(Explanation of violations on following page)

DK 4016, 08/09 (Obsoletes all previous editions which may not be used)

Incorporated: 642-6.003, FAC

ENDatabase v 1.0.1

AP1140004

EID1527791

Page 2 of 3



STATE OF FLORIDA
DEPARTMENT OF HEALTH
ONSITE SEWAGE TREATMENT AND DISPOSAL SYSTEM
EXISTING SYSTEM AND SYSTEM REPAIR EVALUATION

PERMIT # 03-149-14

APPLICANT: A.C.H.A. (13615 SW 156 Terr Archer #1 32618)

CONTRACTOR / AGENT: Pam Moon

LOT: 7 BLOCK: H-27 SUBDIV: Thistle Hill East ID#: 04974-007-02 16-11-18

TO BE COMPLETED BY FLORIDA REGISTERED ENGINEER, DEPARTMENT EMPLOYEE, SEPTIC TANK CONTRACTOR OR OTHER CERTIFIED PERSON. SIGN AND SEAL ALL SUBMITTED DOCUMENTS. COMPLETE ALL APPLICABLE ITEMS. COMPLETE TANK CERTIFICATION BELOW OR NOTE IN REMARKS WHY THE TANKS CANNOT BE CERTIFIED.

EXISTING TANK INFORMATION

[]	GALLONS SEPTIC TANK/GPD ATU	LEGEND: _____	MATERIAL: _____	BAFFLED: [Y / N]
[]	GALLONS SEPTIC TANK/GPD ATU	LEGEND: _____	MATERIAL: _____	BAFFLED: [Y / N]
[]	GALLONS GREASE INTERCEPTOR	LEGEND: _____	MATERIAL: _____	
[]	GALLONS DOSING TANK	LEGEND: _____	MATERIAL: _____	# PUMPS: []

I CERTIFY THAT THE LISTED TANKS WERE PUMPED ON / / BY Myer's, HAVE THE VOLUMES SPECIFIED AS DETERMINED BY [DIMENSIONS / FILLING / LEGEND], ARE FREE OF OBSERVABLE DEFECTS OR LEAKS, AND HAVE A [SOLIDS DEFLECTION DEVICE / OUTLET FILTER DEVICE] INSTALLED.

SIGNATURE OF LICENSED CONTRACTOR	BUSINESS NAME	DATE
----------------------------------	---------------	------

EXISTING DRAINFIELD INFORMATION

[210] SQUARE FEET PRIMARY DRAINFIELD SYSTEM NO. OF TRENCHES [3] DIMENSIONS: 35' x 2'
[] SQUARE FEET _____ SYSTEM NO. OF TRENCHES [] DIMENSIONS: _____
TYPE OF SYSTEM: [☒] STANDARD [] FILLED [] MOUND [] Rock D.A.
CONFIGURATION: [☒] TRENCH [] BED [] _____
DESIGN: [] HEADER [☒] D-BOX [☒] GRAVITY SYSTEM [] DOSED SYSTEM
ELEVATION OF BOTTOM OF DRAINFIELD IN RELATION TO EXISTING GRADE 34 INCHES [ABOVE / BELOW]

SYSTEM FAILURE AND REPAIR INFORMATION

[1967] SYSTEM INSTALLATION DATE TYPE OF WASTE [☒] DOMESTIC [] COMMERCIAL
[400] GPD ESTIMATED SEWAGE FLOW BASED ON [] METERED WATER [☒] TABLE 1, 64E-6, FAC

SITE [] DRAINAGE STRUCTURES [] POOL [] PATIO / DECK [] PARKING
CONDITIONS: [] SLOPING PROPERTY [] _____

NATURE OF [] HYDRAULIC OVERLOAD [] SOILS [] MAINTENANCE [] SYSTEM DAMAGE
FAILURE: [] DRAINAGE / RUN OFF [☒] ROOTS [] WATER TABLE [☒] AGE

FAILURE [☒] SEWAGE ON GROUND [] TANK [] D BOX/HEADER [] DRAINFIELD
SYMPTOM: [☒] PLUMBING BACKUP [] _____

REMARKS/ADDITIONAL CRITERIA

SUBMITTED BY: Pam Moon TITLE/LICENSE M.S.Z.C. DATE: 3/17/14



STATE OF FLORIDA
DEPARTMENT OF HEALTH
ONSITE SEWAGE TREATMENT AND DISPOSAL SYSTEM
SITE EVALUATION AND SYSTEM SPECIFICATIONS

PERMIT # 03-149.14

APPLICANT: Alachua County Housing Authority

AGENT: Dan Moon

LOT: 7 BLOCK: H-27 SUBDIVISION: Thistle Hills East 16-11-18

PROPERTY ID #: 04974-007-000 [Section/Township/Parcel No. or Tax ID Number]

TO BE COMPLETED BY ENGINEER, HEALTH DEPARTMENT EMPLOYEE, OR OTHER QUALIFIED PERSON. ENGINEERS MUST PROVIDE REGISTRATION NUMBER AND SIGN AND SEAL EACH PAGE OF SUBMITTAL. COMPLETE ALL ITEMS.

PROPERTY SIZE CONFORMS TO SITE PLAN: ☒ YES ☐ NO NET USABLE AREA AVAILABLE: 0.23 ACRES
TOTAL ESTIMATED SEWAGE FLOW: 400 GALLONS PER DAY (~~RESIDENCES-TABLE 1~~/OTHER-TABLE 2)
AUTHORIZED SEWAGE FLOW: 575 GALLONS PER DAY [1500 GPD/ACRE OR ~~500 GPD/ACRE~~]
UNOBSTRUCTED AREA AVAILABLE: 1000 SQFT UNOBSTRUCTED AREA REQUIRED: 450 SQFT

BENCHMARK/REFERENCE POINT LOCATION: mail in tree near site
ELEVATION OF PROPOSED SYSTEM SITE IS 30 [INCHES/FT] [ABOVE/BELOW] BENCHMARK/REFERENCE POINT

THE MINIMUM SETBACK WHICH CAN BE MAINTAINED FROM THE PROPOSED SYSTEM TO THE FOLLOWING FEATURES
SURFACE WATER: n/a FT DITCHES/SWALES: n/a FT NORMALLY WET? ☐ YES ☒ NO
WELLS: PUBLIC: n/a FT LIMITED USE: n/a FT PRIVATE: n/a FT NON-POTABLE: n/a FT
BUILDING FOUNDATIONS: 5 FT PROPERTY LINES: 5 FT POTABLE WATER LINES: 20 FT

SITE SUBJECT TO FREQUENT FLOODING: ☐ YES ☒ NO 10 YEAR FLOODING? ☐ YES ☒ NO
10 YEAR FLOOD ELEVATION FOR SITE: n/a FT MSL/NGVD SITE ELEVATION: n/a FT MSL/NGVD

SOIL PROFILE INFORMATION SITE 1 30" below Blm

MUNSELL #/COLOR	TEXTURE	DEPTH
10YR 4/1	FS	0" TO 6"
10YR 4/2	FS	6" TO 24"
10YR 5/3	FS	24" TO 38"
10YR 7/3	FS	38" TO 56"
10YR 7/2	FS	56" TO 72"
10YR 7/2 10YR 5/8 cm 1/1A		TO 60"

USDA SOIL SERIES: maple m. 11 bopp

SOIL PROFILE INFORMATION SITE 2 32" below Blm

MUNSELL #/COLOR	TEXTURE	DEPTH
10YR 4/2	FS	0" TO 8"
10YR 4/3	FS	8" TO 16"
10YR 5/3	FS	16" TO 32"
10YR 7/3	FS	32" TO 50"
10YR 7/2	FS	50" TO 72"
10YR 7/2 10YR 5/8		TO 60"

USDA SOIL SERIES: maple m. 11 bopp

OBSERVED WATER TABLE: 60 INCHES [ABOVE / BELOW] EXISTING GRADE. TYPE: [PERCHED / ~~ADDED~~]
ESTIMATED WET SEASON WATER TABLE ELEVATION: 52 INCHES [ABOVE / BELOW] EXISTING GRADE
HIGH WATER TABLE VEGETATION: ☐ YES ☒ NO MOTTILING: ☒ YES ☐ NO DEPTH: 52 INCHES

SOIL TEXTURE/LOADING RATE FOR SYSTEM SIZING: FS 745/100 DEPTH OF EXCAVATION: n/a INCHES
DRAINFIELD CONFIGURATION: ☒ TRENCH ☐ BED ☐ OTHER (SPECIFY) _____

REMARKS/ADDITIONAL CRITERIA: _____

SITE EVALUATED BY: Dan Moon

DATE: 3/17/14

03-149-14



STATE OF FLORIDA
DEPARTMENT OF HEALTH
ONSITE SEWAGE TREATMENT AND DISPOSAL SYSTEM
CONSTRUCTION PERMIT

PERMIT #: 01-SA-1527791
APPLICATION #: AP1140004
DATE PAID: 3-19-14
FEE PAID: 185.00
RECEIPT #: AP1140004
DOCUMENT #: PR933758

CONSTRUCTION PERMIT FOR: OSTDS Repair

APPLICANT: (Alachua County Housing Authority)

PROPERTY ADDRESS: 13615 SW 156th Ter Archer, FL 32818

LOT: 7 BLOCK: H-27 SUBDIVISION: Thistle Hills East

PROPERTY ID #: 04974-007-000 [SECTION, TOWNSHIP, RANGE, PARCEL NUMBER]
[OR TAX ID NUMBER]

SYSTEM MUST BE CONSTRUCTED IN ACCORDANCE WITH SPECIFICATIONS AND STANDARDS OF SECTION 381.0065, F.S., AND CHAPTER 64E-6, F.A.C. DEPARTMENT APPROVAL OF SYSTEM DOES NOT GUARANTEE SATISFACTORY PERFORMANCE FOR ANY SPECIFIC PERIOD OF TIME. ANY CHANGE IN MATERIAL FACTS, WHICH SERVED AS A BASIS FOR ISSUANCE OF THIS PERMIT, REQUIRE THE APPLICANT TO MODIFY THE PERMIT APPLICATION. SUCH MODIFICATIONS MAY RESULT IN THIS PERMIT BEING MADE NULL AND VOID. ISSUANCE OF THIS PERMIT DOES NOT EXEMPT THE APPLICANT FROM COMPLIANCE WITH OTHER FEDERAL, STATE, OR LOCAL PERMITTING REQUIRED FOR DEVELOPMENT OF THIS PROPERTY.

SYSTEM DESIGN AND SPECIFICATIONS

T | 1,050 | GALLONS / GPD | Septic | CAPACITY
A | 0 | GALLONS / GPD | CAPACITY
N | 0 | GALLONS GREASE INTERCEPTOR CAPACITY [MAXIMUM CAPACITY SINGLE TANK: 1250 GALLONS]
K | 1 | GALLONS Dosing TANK CAPACITY [] GALLONS # [] DOSES PER 24 HRS #Pumps []

D | 300 | SQUARE FEET | repair standard replacement | SYSTEM

R | 0 | SQUARE FEET | SYSTEM

A TYPE SYSTEM: [x] STANDARD [] FILLED [] MOUND []

I CONFIGURATION: [x] TRENCH [] BED []

N

F LOCATION OF BENCHMARK: nail in tree near site

I ELEVATION OF PROPOSED SYSTEM SITE | 30.00 | [] INCHES FT | [] ABOVE [] BELOW BENCHMARK/REFERENCE POINT

E BOTTOM OF DRAINFIELD TO BE | 5 | 64.00 | [] INCHES FT | [] ABOVE [] BELOW BENCHMARK/REFERENCE POINT

L

D FILL REQUIRED: [] 0.00 INCHES EXCAVATION REQUIRED: [] INCHES

O The system is sized for 4 bedrooms with a maximum occupancy of 8 persons (2 per bedroom), for a total estimated flow of 400 gpd. Required drainfield area based on rule 64E-6.015(6)(c)2. ACHD recommends installing 500 Square feet of drainfield to achieve drainfield size requirement.

H The licensed contractor installing the system is responsible for installing the minimum category of tank in accordance with s. 64E-6.013(3)(f), FAC. existing tank not yet certified.

E

R

Private eval shall be verified at installation.

SPECIFICATIONS BY: Ronnie Moore

TITLE: Master Contractor SM 0051476

APPROVED BY: Fred L. Bennett

TITLE: Environmental Specialist I

Alachua CHD

DATE ISSUED: 03/21/2014

EXPIRATION DATE: 06/19/2014

DK 4016, 08/09 (Obsoletes all previous editions which may not be used)

Incorporated: 64E-6.003, FAC

v 1.1.4


AP1140004

52523075

Page 1 of 3

permit # 03-149-14
property ID # 04974-007-000
16-11-18

1 inch = ~~40~~ feet
not to Scale

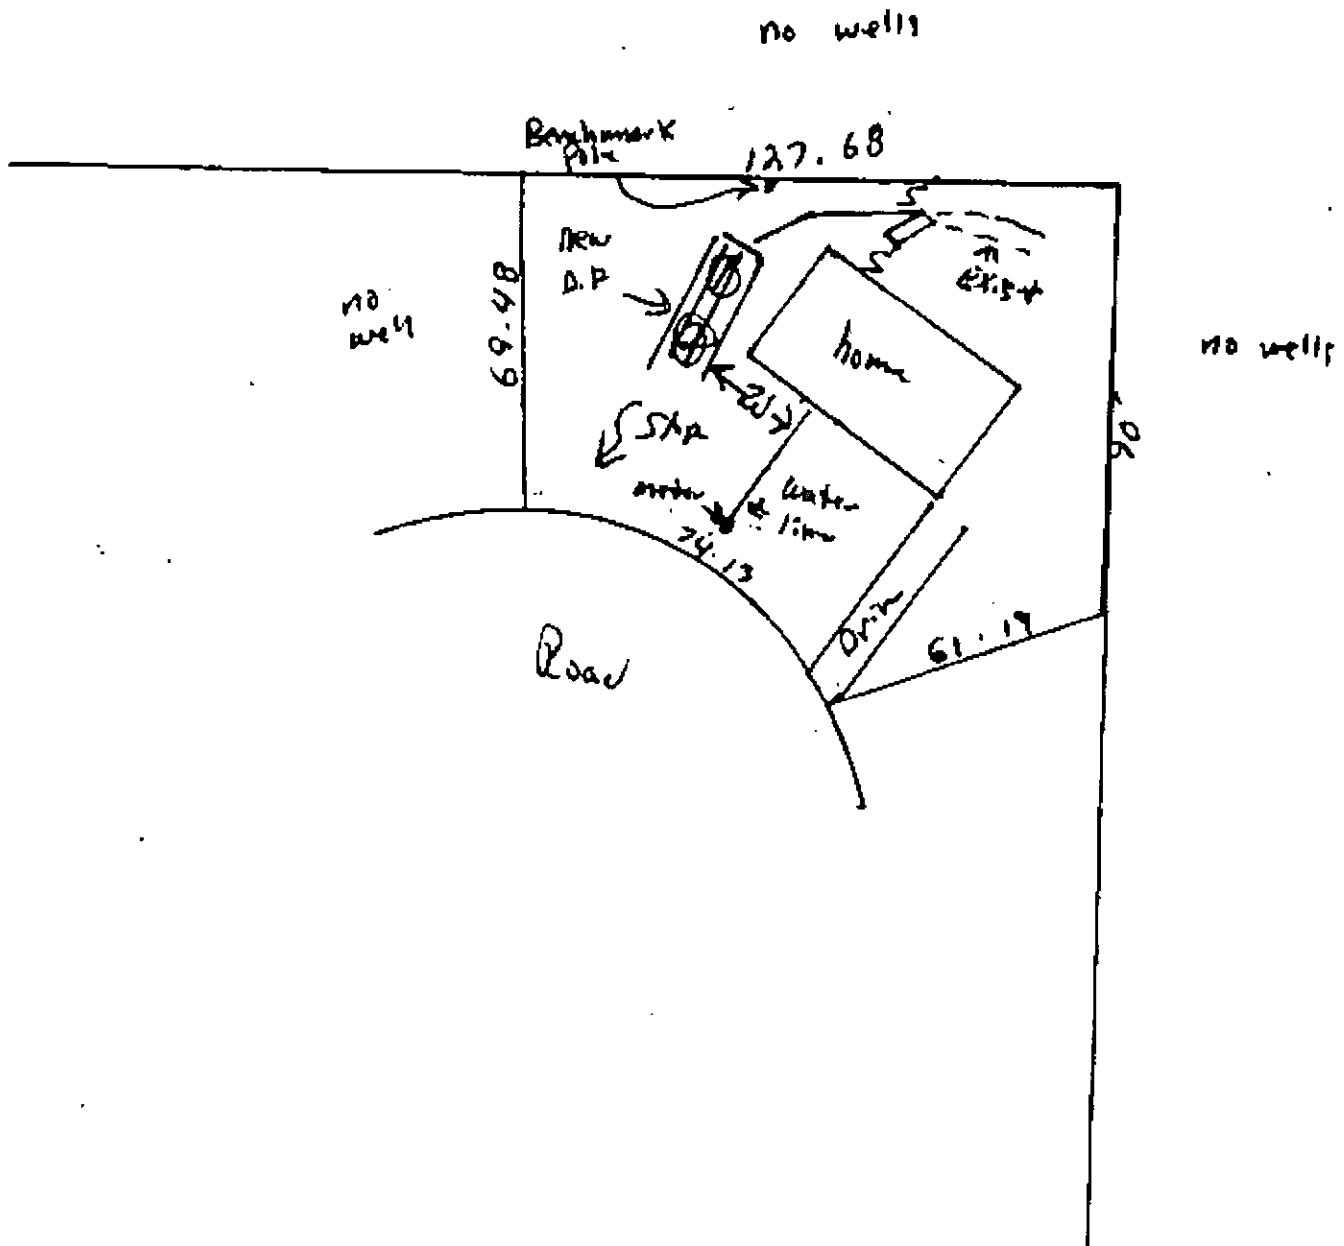

Site Plan submitted by Don Mason M.S.F.C.
Plan Approved ✓ Not Approved _____ Date _____
BY Traci Bennett Alachua County Health Department

05-312-18



STATE OF FLORIDA
DEPARTMENT OF HEALTH
ONSITE SEWAGE TREATMENT AND DISPOSAL SYSTEM
CONSTRUCTION INSPECTION AND FINAL APPROVAL

APPLICATION #: AP1344745
PERMIT #: 01-SA-1847462
DOCUMENT #: F11193412
DATE PAID: 05/15/2018
FEE PAID: 185.00
RECEIPT #: 1-PID-3544944

APPLICANT: Alachua County Housing Authority Lot 7

AGENT: Newsome Well and Septic

PROPERTY ADDRESS: 13615 SW 156th Ter Archer, FL 32618

LOT: 7

BLOCK:

SUBDIVISION: Thistle Hills East

ID#: 04974-007-000

CHECKED [X] ITEMS ARE NOT IN COMPLIANCE WITH STATUTE OR RULE AND MUST BE CORRECTED.

TANK INSTALLATION

[] [01] TANK SIZE [1] 900.00 [2] —
[] [02] TANK MATERIAL Concrete
[] [03] OUTLET DEVICE —
[] [04] MULTI-CHAMBERED [] Y [] N
[] [05] OUTLET FILTER —
[] [06] LEGEND 1. Unknown 2. —
[] [07] WATERTIGHT
[] [08] LEVEL
[] [09] DEPTH TO LID

DRAINFIELD INSTALLATION

[] [10] AREA [1] 408 [2] — SQFT
[] [11] DISTRIBUTION BOX — HEADER X
[] [12] NUMBER OF DRAINLINES 1. 3.00 2. —
[] [13] DRAINLINE SEPARATION
[] [14] DRAINLINE SLOPE
[] [15] DEPTH OF COVER
[] [16] ELEVATION [] ABOVE [] BELOW BM 51.00
[] [17] SYSTEM LOCATION
[] [18] DOSING PUMPS —
[] [19] AGGREGATE SIZE
[] [20] AGGREGATE EXCESSIVE FINES
[] [21] AGGREGATE DEPTH

FILL / EXCAVATION MATERIAL

[] [22] FILL AMOUNT
[] [23] FILL TEXTURE
[] [24] EXCAVATION DEPTH
[] [25] AREA REPLACED
[] [26] REPLACEMENT MATERIAL

SETBACKS

[] [27] SURFACE WATER — FT
[] [28] DITCHES — FT
[] [29] PRIVATE WELLS — FT
[] [30] PUBLIC WELLS — FT
[] [31] IRRIGATION WELLS — FT
[] [32] POTABLE WATER 60 FT
[] [33] BUILDING FOUNDATIONS 5 FT
[] [34] PROPERTY LINES 7 FT
[] [35] OTHER — FT

FILLED / MOUND SYSTEM

[] [36] DRAINFIELD COVER
[] [37] SHOULDERS
[] [38] SLOPES
[] [39] STABILIZATION —

ADDITIONAL INFORMATION

[] [40] UNOBSTRUCTED AREA
[] [41] STORMWATER RUNOFF
[] [42] ALARMS
[] [43] MAINTENANCE AGREEMENT
[] [44] BUILDING AREA
[] [45] LOCATION CONFORMS WITH SITE PLAN
[] [46] FINAL SITE GRADING
[] [47] CONTRACTOR Kyle Myers (Newsome Well &
[] [48] OTHER INFILTRATOR Quick4 EQ36 (single c

ABANDONMENT

[] [49] TANK PUMPED —
[] [50] TANK CRUSHED & FILLED

Comments: Comments are on page 2.

Not installed according to approved site plan. See As-built. Was installed in area of original site eval and not the revised site eval.

CONSTRUCTION [] APPROVED / DISAPPROVED [] Fred L Bennett Alachua CHD DATE: 06/14/2018
Environmental Specialist II Fred L Bennett (Department of Health in Ala

FINAL SYSTEM [] APPROVED / DISAPPROVED [] Fred L Bennett Alachua CHD DATE: 06/14/2018
Environmental Specialist II Fred L Bennett (Department of Health in Ala

(Explanation of Violations on following page)

DH 4016, 08/09 (Obsoletes all previous editions which may not be used)

Incorporated: 64E-6.003, FAC

Page 2 of 3

SW Database ID
EMAILED

AP1344745

EID1847462

OK



STATE OF FLORIDA
DEPARTMENT OF HEALTH
ONSITE SEWAGE TREATMENT AND DISPOSAL SYSTEM
CONSTRUCTION INSPECTION AND FINAL APPROVAL

APPLICATION #: AP1344745
PERMIT #: 01-SA-1847462
DOCUMENT #: FI1193412
DATE PAID: 05/15/2018
FEE PAID: 185.00
RECEIPT #: 1-PID-3544944

<u>Violation Number</u>	<u>Comment</u>

Comments

Existing tank information per DH4015 page 4. soil sok



STATE OF FLORIDA
DEPARTMENT OF HEALTH
ONSITE SEWAGE TREATMENT AND DISPOSAL SYSTEM
SITE EVALUATION AND SYSTEM SPECIFICATIONS

PERMIT #. 05-312-18

APPLICANT: Alachua County Housing Authority AGENT: Newsome Well & Septe

LOT: 7 BLOCK: _____ SUBDIVISION: Thistle Hills East

PROPERTY ID #: 04974-007-000 [Section/Township/Parcel No. or Tax ID Number]

TO BE COMPLETED BY ENGINEER, HEALTH DEPARTMENT EMPLOYEE, OR OTHER QUALIFIED PERSON. ENGINEERS MUST PROVIDE REGISTRATION NUMBER AND SIGN AND SEAL EACH PAGE OF SUBMITTAL. COMPLETE ALL ITEMS.

PROPERTY SIZE CONFORMS TO SITE PLAN: ☒ YES ☐ NO NET USABLE AREA AVAILABLE: 2.26 ACRES
TOTAL ESTIMATED SEWAGE FLOW: 400 GALLONS PER DAY [RESIDENCES-TABLE 1/OTHER-TABLE 2]
AUTHORIZED SEWAGE FLOW: 650 GALLONS PER DAY [1500 GPD/ACRE OR 2500 GPD/ACRE]
UNOBSTRUCTED AREA AVAILABLE: 1000 SQFT UNOBSTRUCTED AREA REQUIRED: 600 SQFT

BENCHMARK/REFERENCE POINT LOCATION: Orange Painted Nail in Power Pole at site.
ELEVATION OF PROPOSED SYSTEM SITE IS 25 (INCHES/FT) [ABOVE/BELOW] BENCHMARK/REFERENCE POINT

THE MINIMUM SETBACK WHICH CAN BE MAINTAINED FROM THE PROPOSED SYSTEM TO THE FOLLOWING FEATURES
SURFACE WATER: NA FT DITCHES/SWALES: NA FT NORMALLY WET? ☐ YES ☒ NO
WELLS: PUBLIC: NA FT LIMITED USE: NA FT PRIVATE: NA FT NON-POTABLE: NA FT
BUILDING FOUNDATIONS: 7 FT PROPERTY LINES: 10 FT POTABLE WATER LINES: 26 FT

SITE SUBJECT TO FREQUENT FLOODING: ☐ YES ☒ NO 10 YEAR FLOODING? ☐ YES ☒ NO
10 YEAR FLOOD ELEVATION FOR SITE: _____ FT MSL/NGVD SITE ELEVATION: _____ FT MSL/NGVD

SOIL PROFILE INFORMATION SITE 1

25" below RP

MUNSELL #/COLOR	TEXTURE	DEPTH
10YR 4/1	FS	0 TO 6
10YR 4/2	FS	6 TO 19
10YR 6/4, 4/4	FS	19 TO 32
10YR 5/4, 7.5YR 5/6	SL	32 TO 40
10YR 6/4, 7.5YR 5/6, 5/8	SL SL	40 TO 50
10YR 5/4, 6/3, 7.5YR 5/6	LS	50 TO 68
10YR 6/4, 7.5YR 5/6, 5/8	SL	68 TO 72
		TO
		TO

USDA SOIL SERIES: Mapped Arcedondo

SOIL PROFILE INFORMATION SITE 2

27" below RP

MUNSELL #/COLOR	TEXTURE	DEPTH
10YR 4/1, 4/2	FS	0 TO 14
10YR 5/4, 4/4	FS	14 TO 24
10YR 6/4, 8/1	FS	24 TO 45
10YR 5/6	FS	24 TO 45
10YR 8/2, 8/1	FS	45 TO 50
7.5YR 5/6	FS	45 TO 50
7.5YR 5/6	LS	50 TO 56
7.5YR 5/6, 5/8	SL	56 TO 72
10YR 6/4	SL	56 TO 72

USDA SOIL SERIES: Mapped Arcedondo

OBSERVED WATER TABLE: 72 INCHES [ABOVE/BELOW] EXISTING GRADE. TYPE: [PERCHED/APPARENT]
ESTIMATED WET SEASON WATER TABLE ELEVATION: 72 INCHES [ABOVE/BELOW] EXISTING GRADE
HIGH WATER TABLE VEGETATION: ☐ YES ☒ NO MOTTILING: ☒ YES ☐ NO DEPTH: 45 INCHES

SOIL TEXTURE/LOADING RATE FOR SYSTEM SIZING: .8 FS/table IX DEPTH OF EXCAVATION: old ground INCHES
DRAINFIELD CONFIGURATION: ☒ TRENCH ☒ BED ☐ OTHER (SPECIFY) _____
REMARKS/ADDITIONAL CRITERIA: Replace to Repair Standards

SITE EVALUATED BY: [Signature] CEHP 17-1159 DATE: 5/8/18

6/1/18 Contractor installed in this area
& not the area of 6/1/18 site eval

Kyle
Newsome
STATE OF FLORIDA
DEPARTMENT OF HEALTH
ONSITE SEWAGE TREATMENT AND DISPOSAL SYSTEM
CONSTRUCTION INSPECTION AND FINAL APPROVAL

PERMIT NO. 5-312-18
DATE PAID: 5/15/18
FEE PAID: 185.00
RECEIPT #: 43763402
AP1344745

AGENT: Alachua County Housing Authority

AGENT:

PROPERTY ADDRESS: 13615 SW 156th Terrace Archer FL 32618
LOT: 7 BLOCK: SUBDIVISION: Thistle Hills East PROPERTY ID #: 04974-007-000

CHECKED [X] ITEMS ARE NOT IN COMPLIANCE WITH STATUTE OR RULE AND MUST BE CORRECTED.

TANK INSTALLATION

- [] [01] TANK SIZE [1] 900 [2]
[] [02] TANK MATERIAL Concrete
[] [03] OUTLET DEVICE
[] [04] MULTI-CHAMBERED [Y / N]
[] [05] OUTLET FILTER
[] [06] LEGEND unk
[] [07] WATERTIGHT
[] [08] LEVEL
[] [09] DEPTH TO LID

2 x 11 + 12

DRAINFIELD INSTALLATION

- [] [10] AREA [1] 408 [2] SQFT
[] [11] DISTRIBUTION BOX HEADER ✓
[] [12] NUMBER OF DRAINLINES 3
[] [13] DRAINLINE SEPARATION
[] [14] DRAINLINE SLOPE
[] [15] DEPTH OF COVER
[] [16] ELEVATION [ABOVE (BELOW) BM 26" NG
[] [17] SYSTEM LOCATION
[] [18] DOSING PUMPS
[] [19] AGGREGATE SIZE
[] [20] AGGREGATE EXCESSIVE FINES
[] [21] AGGREGATE DEPTH

FILL / EXCAVATION MATERIAL

- [] [22] FILL AMOUNT
[] [23] FILL TEXTURE
[] [24] EXCAVATION DEPTH
[] [25] AREA REPLACED
[] [26] REPLACEMENT MATERIAL

SETBACKS

- [] [27] SURFACE WATER FT
[] [28] DITCHES FT
[] [29] PRIVATE WELLS FT
[] [30] PUBLIC WELLS FT
[] [31] IRRIGATION WELLS FT
[] [32] POTABLE WATER LINES 60 FT
[] [33] BUILDING FOUNDATION 5 FT
[] [34] PROPERTY LINES 7 FT
[] [35] OTHER FT

FILLED / MOUND SYSTEM

- [] [36] DRAINFIELD COVER
[] [37] SHOULDERS
[] [38] SLOPES
[] [39] STABILIZATION

ADDITIONAL INFORMATION

- [] [40] UNOBSTRUCTED AREA
[] [41] STORMWATER RUNOFF
[] [42] ALARMS
[] [43] MAINTENANCE AGREEMENT
[] [44] BUILDING AREA
[] [45] LOCATION CONFORMS WITH SITE PLAN
[] [46] FINAL SITE GRADING
[] [47] CONTRACTOR Newsome
[] [48] OTHER 34 Apr 27 Ry 69 36

ABANDONMENT

- [] [49] TANK PUMPED / /
[] [50] TANK CRUSHED & FILLED / /

EXPLANATION OF VIOLATIONS / REMARKS:

- [] Soils ok
[] Provide soil & site plan

CONSTRUCTION [APPROVED/DISAPPROVED]: Fred Bennett Alachua CHD DATE: 6-14-18
FINAL SYSTEM [APPROVED/DISAPPROVED]: Fred Bennett Alachua CHD DATE: 6-14-18
FH 4016, 08/09 (Obsoletes all previous editions which may not be used)
Incorporated: 64E-6.003, FAC

PERMIT NUMBER:

Permit tracking number assigned by CHD.

APPLICANT:

Property owner's full name.

AGENT:

Property owner's legally authorized representative.

MAILING ADDRESS:

P.O. box or street mailing address for applicant or agent.

LOT, BLOCK, SUBDIVISION

PROPERTY ID#:

Lot, Block and Subdivision for lot or

27 character number for property. (property appraiser ID # or GIS location)

COUNTY HEALTH DEPARTMENT CHECKS [X] ITEMS NOT IN COMPLIANCE WITH CONSTRUCTION PERMIT AND STATUTE OR RULE. INFORMATION IS COMPLETED BY CHD ON FOLLOWING ITEMS:

TANK SIZE (gallons)

TANK MATERIAL (concrete, fiberglass, etc)

OUTLET FILTER (manufacturer, make, model)

LEGEND (manufacturer code)

DRAINFIELD AREA (square feet)

DISTRIBUTION BOX / HEADER (check box)

NUMBER OF DRAINLINES (number installed)

SYSTEM ELEVATION (in relation to BM)

DOSING PUMPS (number installed)

SETBACKS (record actual setbacks in ft)

SETBACKS OTHER (as required)

STABILIZATION (date stabilized)


CONTRACTOR (contractor installing system)

ADDITIONAL INFORMATION (as required)

ABANDONMENT TANK PUMPED (date)

TANK CRUSHED AND FILLED (date)

AS BUILT INSTALLATION SKETCH



EXPLANATION OF VIOLATIONS:

Record item number, explanation of violation, and required corrective action.

CONSTRUCTION APPROVAL:

Circle approved or disapproved, CHD signature and date.

FINAL APPROVAL:

Circle approved or disapproved. CHD signature and date of approval.

Final approval shall not be granted until the CHD has confirmed that building construction and lot grading are in substantial compliance with plans and specifications submitted with the permit application.

ELEVATION WORKSHEET

ELEVATION OF BENCHMARK OR REFERENCE POINT: _____

[+] SHOT

H.I.

ELEVATION

EXISTING GROUND

H.I.

[-] SHOT

TOP OF AGGREGATE

H.I.

[-] SHOT


H.I.

[-] SHOT

13615 156TH Terr
Archer, FL

Revised 6/1/18

4
N

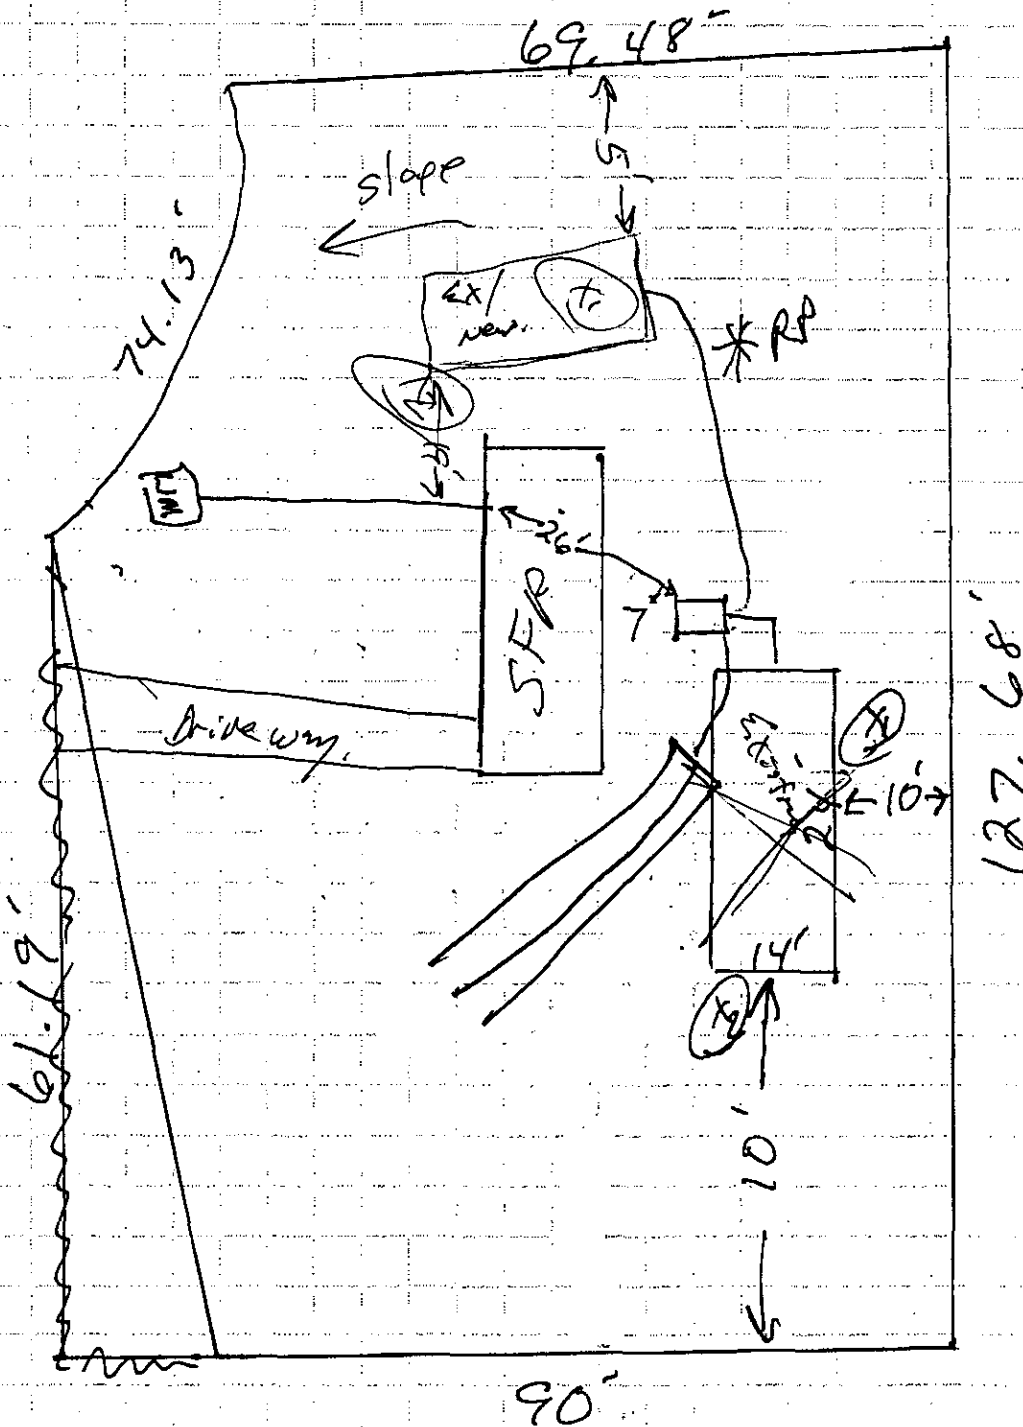

[Signature]

NOT TO SCALE.

5/8/18. Approval: *David Garrison*
Secur 6/5/18

Harris, Todd S

From: Harris, Todd S
Sent: Thursday, May 31, 2018 2:26 PM
To: 'flsepticsolutions@yahoo.com'
Subject: 05-312-18 Lot 7 TH E

- Existing drainfield amount is 405 ft² from repair 4 years ago
 - Revise 4015 and associated calcs
 - Is age still a cause of system failure?
- Existing drainfield location not shown on site plan
- Driveway and parking area not shown on site plan
- ~~Soil profiles~~ should be done over proposed drainfield area
 - Appears should be Table VII based on the soil texture *NA*
 - Installing in bed as Table VII will require greater area than indicated *NA*
 - Can the df fit in this area? House is angled and a lot bigger than indicated on plan
 - Appears there should be a 45" ESHWT based on description and mottling(?) but listed as 72


Todd Harris
Environmental Manager
Florida Department of Health in Alachua County
224 SE 24th St.
Gainesville, FL 32641
Office 352-334-7932
Fax 352-334-7935

Please note: Florida has a very broad public records law. Most written communications to or from state officials regarding state business are public records available to the public and media upon request. Your e-mail communications may therefore be subject to public disclosure

(SCL)

Waley Rock


} 12 4



SCALE 1'-50'

THISTLE HILLS ... EAST IN THE SE 1/4 OF SECTION 16 - T 11 S - R 18 E CITY OF ARCHER, ALACHUA COUNTY, FLORIDA

PLAT BOOK H PAGE 27



Lot	Area	Owner
1	1/2 Acre	THISTLE HILLS EAST
2	1/2 Acre	THISTLE HILLS EAST
3	1/2 Acre	THISTLE HILLS EAST
4	1/2 Acre	THISTLE HILLS EAST
5	1/2 Acre	THISTLE HILLS EAST
6	1/2 Acre	THISTLE HILLS EAST
7	1/2 Acre	THISTLE HILLS EAST
8	1/2 Acre	THISTLE HILLS EAST
9	1/2 Acre	THISTLE HILLS EAST
10	1/2 Acre	THISTLE HILLS EAST
11	1/2 Acre	THISTLE HILLS EAST
12	1/2 Acre	THISTLE HILLS EAST
13	1/2 Acre	THISTLE HILLS EAST
14	1/2 Acre	THISTLE HILLS EAST
15	1/2 Acre	THISTLE HILLS EAST

DESCRIPTION: This plat contains 15 lots, each 1/2 acre, situated in the SE 1/4 of Section 16, Township 11 South, Range 18 East, City of Archer, Alachua County, Florida. The lots are numbered 1 through 15. The plat was prepared by the County Surveyor, Alachua County, Florida, on this 24th day of June, 1970.

WITNESSES MY HAND AND OFFICIAL SEAL THIS 24th day of June, 1970.

Ray C. Thistle COUNTY CLERK

Paul J. Thistle COUNTY CLERK

Paul J. Thistle COUNTY CLERK

Paul J. Thistle COUNTY CLERK

Paul J. Thistle COUNTY CLERK

Paul J. Thistle COUNTY CLERK

Paul J. Thistle COUNTY CLERK

Paul J. Thistle COUNTY CLERK

Paul J. Thistle COUNTY CLERK

Paul J. Thistle COUNTY CLERK

Paul J. Thistle COUNTY CLERK

Paul J. Thistle COUNTY CLERK

Paul J. Thistle COUNTY CLERK

Paul J. Thistle COUNTY CLERK

Paul J. Thistle COUNTY CLERK

Paul J. Thistle COUNTY CLERK

Paul J. Thistle COUNTY CLERK

Paul J. Thistle COUNTY CLERK

Paul J. Thistle COUNTY CLERK

Paul J. Thistle COUNTY CLERK

Paul J. Thistle COUNTY CLERK

Paul J. Thistle COUNTY CLERK

Paul J. Thistle COUNTY CLERK

Paul J. Thistle COUNTY CLERK

Paul J. Thistle COUNTY CLERK

Paul J. Thistle COUNTY CLERK

Paul J. Thistle COUNTY CLERK

Paul J. Thistle COUNTY CLERK

Paul J. Thistle COUNTY CLERK

Paul J. Thistle COUNTY CLERK

Paul J. Thistle COUNTY CLERK

Paul J. Thistle COUNTY CLERK

Paul J. Thistle COUNTY CLERK

H



Property Search Results

The data displayed is the most current data available to the Property Appraiser.

Search Date: 5/15/2018 at 8:27:43 AM

Printer Friendly Page

Parcel: 04974-007-000

GIS Map

Taxpayer:	ALACHUA COUNTY HOUSING, AUTHOR	Legal: THISTLE HILLS EAST PB H-27 LOT 7 OR 804/350
Mailing:	701 NE 1ST ST GAINESVILLE, FL 32601	
9-1-1 Address:	13615 SW 156TH TER ARCHER	
Sec-Twn-Rng:	16-11-18	
Property Use:	08600 - Cty Inc Nonmuni	
Tax Jurisdiction:	Archer 2700	
Area:	City of Archer	
Subdivision:	Thistle Hills East	


Year	Property Use	Land Value	Land Just Value	Building Value	Misc Value	Total Just Value	Deferred Value	County Assessed	School Assessed	County Exempt	School Exempt	County Taxable	School Taxable
2017	Cty Inc Nonmuni	16000	16000	46400	100	62500	0	62500	62500	62500	62500	0	0
2016	Cty Inc Nonmuni	16000	16000	43400	100	59500	0	59500	59500	59500	59500	0	0
2015	Cty Inc Nonmuni	16000	16000	44300	100	60400	0	60400	60400	60400	60400	0	0
2014	Cty Inc Nonmuni	16000	16000	44500	100	60600	0	60600	60600	60600	60600	0	0
2013	Cty Inc Nonmuni	16000	16000	45400	100	61500	0	61500	61500	61500	61500	0	0
2012	Cty Inc Nonmuni	16000	16000	46300	100	62400	0	62400	62400	62400	62400	0	0
2011	Cty Inc Nonmuni	16000	16000	48900	100	65000	0	65000	65000	65000	65000	0	0
2010	Cty Inc Nonmuni	16000	16000	51700	100	67800	0	67800	67800	67800	67800	0	0
2009	Cty Inc Nonmuni	16000	16000	56000	100	72100	0	72100	72100	72100	72100	0	0
2008	Single Family	16000	16000	62200	100	78300	0	78300	0	78300	0	0	0

Land

Use	Zoning Type	Zoning Desc	Unit Type	Units
SFR	R-2		Unit	1

Building

Actual Year Built	1967
Effective Year Built	1967
Building Quality	Average
Building Style	01
Building Use	0100 - Single Family
Bedrooms	4
Baths	1.5
Stories	1.0
Exterior Wall 1	Concrete Block
Exterior Wall 2	N/A
Interior Wall 1	Drywall
Interior Wall 2	N/A
Floor Cover 1	Cork Tile
Floor Cover 2	N/A
Roof Cover	Asphalt
Roof Structure	Gable/Hip
AC	Roof Top Air
Heating Type	Convection
Heating System	Electric
Total Square Feet	1304
Heated Square Feet	1224
Area Type	Square Footage
BAS (BASE AREA)	1224



Miscellaneous

Description	Unit Type	Units
4680 - Paving 1	SF	250

Permit

County Permit information is supplied by the Alachua County Office of Codes Enforcement. The Alachua County Office of Codes Enforcement and the Property Appraiser's Office assume no liability whatsoever associated with the use or misuse of this public information data and will not be held liable as to the validity, correctness, accuracy, completeness, and / or reliability of this data.

Permit Number	Permit Type	Issue Date	Final Date	Appraisal Date	Comment
2015110332	RR	11/19/2015	11/30/2015	01/11/2016	RE-ROO SFD WITH SHINGL
2015110300	RAD	11/17/2015	01/08/2016	01/11/2016	ROOF REPAIR(2 TRUSSES

[Link to TaxCollector Record](#)

The information that is supplied by the Alachua County Property Appraiser's office is public information data and must be accepted and used with the understanding that the data was collected primarily for the use and purpose of creating a Property Tax Roll per Florida Statute. The Alachua County Property Appraiser's Office will not be held liable as to the validity, correctness, accuracy, completeness, and / or reliability of this data. The Alachua County Property Appraiser's Office furthermore assumes no liability whatsoever associated with the use or misuse of this public information data.

Alachua County Property Appraiser • 515 N Main Street Suite 200 • Gainesville, FL 32601 • 352-374-5230 (FAX) 352-374-5278

